



# Records - Toshiba UNINTERRUPTIBLE POWER SYSTEM 1600XP Installation And Operation Manual


Single phase - 3.6/6/8/10/14/18/22 kva



1  
2  
3  
4  
5  
6  
Table Of Contents  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16  
17

18  
19  
20  
21  
22  
23  
24  
25  
26  
27  
28  
29  
30  
31  
32  
33  
34  
35  
36  
37  
38  
39  
40  
41  
42  
43  
44  
45  
46  
47  
48  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65  
66  
67

68  
69  
70  
71  
72  
73  
74  
75  
76  
77  
78  
79  
80  
81  
82  
83  
84  
85  
86  
87  
88  
89  
90



•

[Table of Contents](#)

•

## Bookmarks







## Records

if the selected record contains no records, the display will return the message "no record."



Each record file can be accessed by pressing the labeled key, and the records paged through using the standard next record, previous record, first record, and last record control keys at the bottom of the touchscreen. (See page 34.)

Samples of the five record screens and the data they record are shown below.

HOME  
USR

Records  
Test Record



rec no.  
1  
time  
12:54:17  
date  
04/14/09  
Sout  
240/60Hz  
Sin  
240/60Hz  
Vout  
98  
%  
Vin  
98  
%  
Vdc  
101 %  
iout  
84  
%  
Vbst  
92  
%  
result  
pASS  
type  
battery  
trigger source: diSPly  
1 / 32

**TOSHIBA**  
Leading Innovation >>>

HOME  
USR

### Backup Record





rec no.  
2  
date  
04/15/09  
Sin  
240/60Hz  
Vin  
24  
iout  
84  
Vbst  
92  
backup  
140  
trigger source: ViVU

1600Xp Series installation and operation manual  
SAMPLE RECORD SCREENS

HOME  
USR

### Fault Record

rec no.  
803  
time  
date  
04/14/09  
Sout  
Sin  
240/60Hz  
Vout  
Vin  
99  
%  
Vdc  
iout  
89  
%  
Vbst  
92  
%  
VoUV  
1 / 16

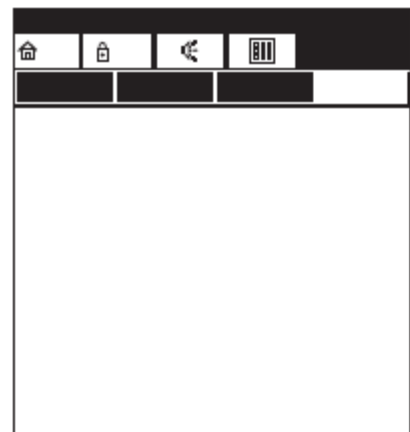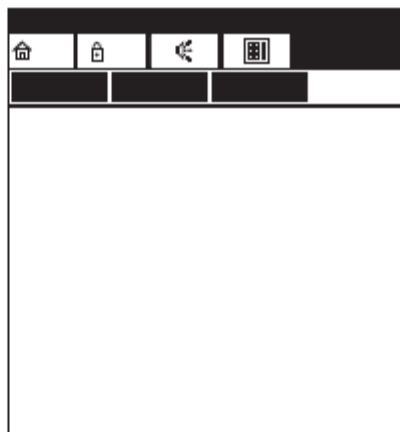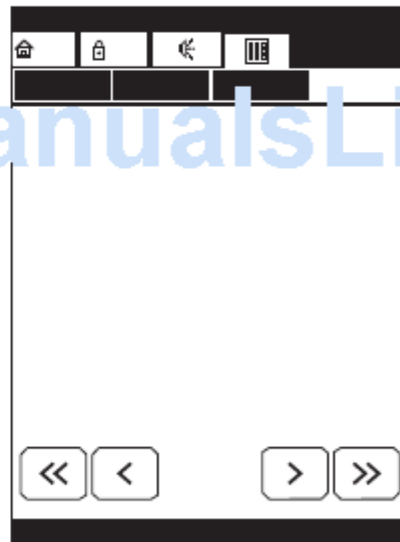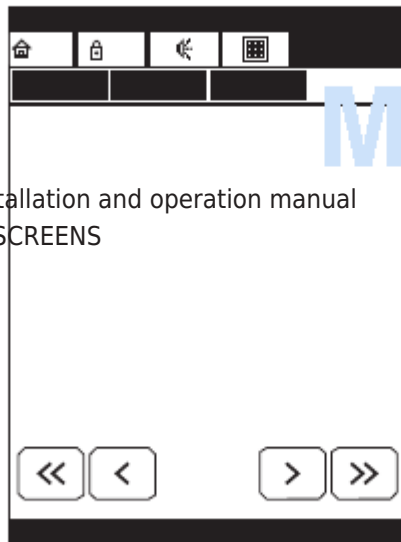

HOME

Records

### Operational Record

rec no.  
 time  
 10:17:29  
 date  
 Sout  
 240/60Hz  
 Sin  
 Vout  
 98  
 %  
 Vin  
 Vdc  
 101 %  
 %  
 Iout  
 Vbend  
 92  
 %  
 %  
 Vbst  
 s  
 From  
 branch  
 1 / 2



HOME

NO RECORD

EMPTY BUFFER SCREEN



HOME

USR

Records

### Warning Record

rec no.  
 0  
 12:54:17  
 time  
 date  
 04/15/09  
 240/60Hz  
 Sout  
 Sin  
 240/60Hz  
 98  
 %  
 Vout  
 Vin  
 98  
 %  
 101 %  
 Vdc  
 Iout  
 88  
 %  
 Vbst  
 135 %  
 CHrgoV  
 1 / 1

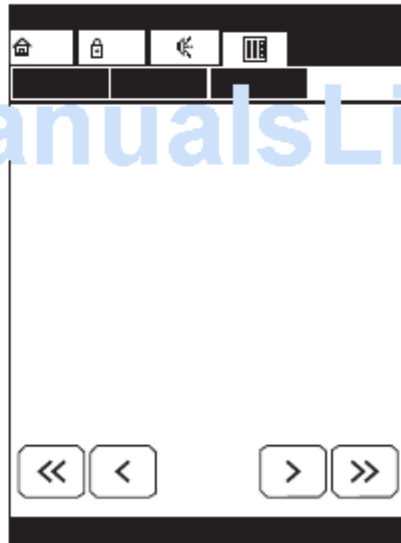
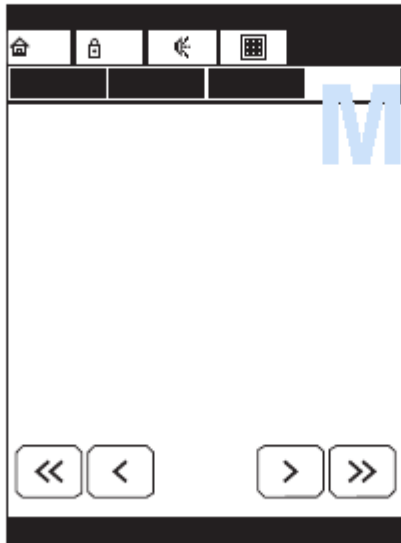


ManualsLib.com

USR

Records

124  
 time  
 9:51:50  
 04/15/09  
 Sout  
 240/60Hz  
 240/60Hz  
 Vout  
 99  
 %

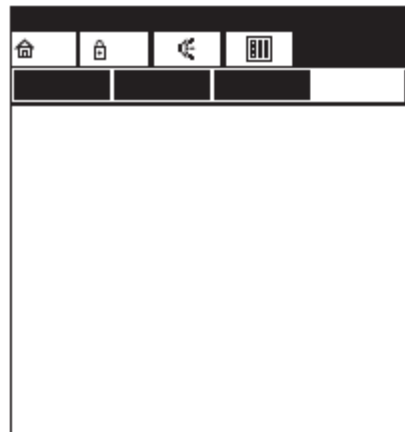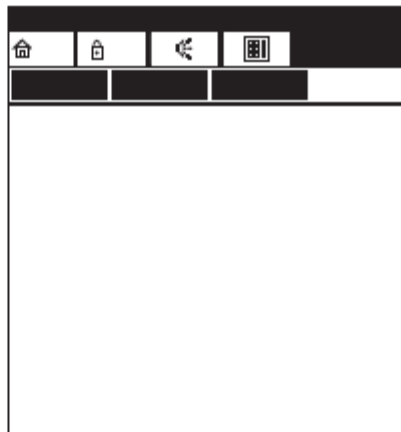

99  
%  
Vdc  
101 %  
92  
%  
92  
%  
to

**TOSHIBA**  
Leading Innovation >>>

on-line  
bypnorm  
why  
fc  
6  
1 / 32

USR

Records  
1 / 32

Records  
12:11:51  
240/60Hz  
98  
%  
101 %

61



[Table of Contents](#)

[Previous Page](#)  
[Next Page](#)

1  
...  
66  
67  
68  
69  
70  
71  
72  
73



## Related Manuals for Toshiba UNINTERRUPTIBLE POWER SYSTEM 1600XP

### [UPS Toshiba 1600XP Specifications](#)

Single phase uninterruptible power systems (9 pages)

### [UPS Toshiba 1600XP SERIES Installation And Operation Manual](#)

(140 pages)

### [UPS Toshiba 1600XP SERIES Installation And Operation Manual](#)

1600xp series single phase - 3.6/6/8/10/14/18/22 kva (100 pages)

### [UPS Toshiba 1600XPi Series Installation And Operation Manual](#)

8-22kva battery cabinet (23 pages)

### [UPS Toshiba 1600XP SERIES Installation And Operation Manual](#)

8-22kva battery cabinet (22 pages)

### [UPS Toshiba 1600XP Series Quick Installation Manual](#)

(4 pages)

### [UPS Toshiba 1600EP SERIES Instruction Manual](#)

(58 pages)

### [UPS Toshiba 1600EP Series Operation Manual](#)

Battery cabinet system single phase- 8/10/14/18 kva (16 pages)

### [UPS Toshiba 1600EP Series Operation Manual](#)

Battery cabinet system single phase - 3.6/6.0 kva (22 pages)

### [UPS Toshiba 1600 Series Product Specifications](#)

3.6kva 208/240v in - 208/240/120v out tower hardwire solution (3 pages)

### [UPS Toshiba 1600 Series Product Specifications](#)

Uninterruptible power systems, 3.6kva 240v in - 240v out tower maintenance bypass solution (2 pages)

### [UPS Toshiba 1600EP Series Quick Installation Manual](#)

(4 pages)

### [UPS Toshiba 1600 Series Instruction Manual](#)

Single phase - 2.4/3.6/6/8 kva plus (49 pages)

### [UPS Toshiba 1600XPi Series Installation And Operation Manual](#)

Single phase - 3.6/5.2/6/8/10/14/18/22 kva (140 pages)

### [UPS Toshiba 1500 Plus Series Operation Manual](#)

6/.8/1.0 kva 220v uninterruptible power system (31 pages)

### [UPS Toshiba UT1A1A010C6 User Manual](#)

User guide (51 pages)

## Related Content for Toshiba UNINTERRUPTIBLE POWER SYSTEM 1600XP

### [1600XP SERIES Records](#)

[Toshiba 1600XP SERIES](#)

### [1600XP SERIES Records](#)

[Toshiba 1600XP SERIES](#)

This manual is also suitable for:

[1600xp serie1600xp series](#)